



BUILDING RESEARCH INSTITUTE (NISI) Ltd.

NOTIFIED TEST LABORATORY

Identification number NB 2032 of the Register of EC

Licence granted by the Ministry of Development and Public Works (MRRB), No CPD 10-2032

1618 Sofia, BULGARIA, 86 Nikola Petkov Blvd, tel.+359 2 856 10 82, fax +359 2 955 96 38, e-mail: nisi_sofia@abv.bg

TEST REPORT
INITIAL TYPE TESTING
ITT-15.28 / 28.01.2016

The tests are carried out in compliance with the Chapter Two of the Bulgarian *Regulation for the Essential Requirements to Constructions and Conformity Assessment of Construction Products (RERCCACP)* that bring into force the *Construction Products Directive (CPD) 89/106/EEC* of the Council of European Communities.

Product: Window aluminum profiles „VIVA ALUMINIUM SYSTEMS“
Opening system with thermal break TBO 55

Producer: Factory of VIAS Ltd,
Bulgaria, Shumen, 68A “Rishki prohod“ Blvd.

Applicant: VIAS Ltd,
Bulgaria, Shumen, 68A “Rishki prohod“ Blvd.

Document for assignment: Contract № 40/2015

Test samples: One window with dimensions 1750/2550 mm.
Details of the window are supplied in Annex 1.

Test period: From 24.11.2015 to 26.01.2016

Assessment of the performance: The submitted Window aluminum profiles „VIVA ALUMINIUM SYSTEMS“ opening system with thermal break TBO 55 meets watertightness class 9A and class 7B, resistance to wind load class C2, load-bearing capacity devices class 4, air permeability class 4, weighted sound reduction index $R_w (C; C_{tr}) = 37 (-1; -2)$ dB; thermal transmittance $U_w = 0,914$ W/(m².K).

Head of Test Laboratory:
Res. Ass. Eng. Tsvetana Gyurova

General Manager of NISI:
Prof. Dr. Eng. Rumen Guglev



The Test Report consists of 12 pages.
Copies of separate parts of the Test Report can be made with written consent of the NISI Ltd.

Testing data:

No	Characteristic	Unit of measurement	Test method	Test result	Requirement according
1	2	3	4	5	6
1.	Watertightness in static test pressure P = 100 Pa *	class	EN 1027 Method A	3A	EN 12208 The requirements are given in Annex 2 of the test report.
* Detailed test results are given in Annex 2 of the test report.					
2.	Resistance to wind load *	class		C2	EN 12210
2.1	Deformation (F _p) of the wing frame at wind load : - I-st vertical axis (point 2); - II-nd vertical axis (point 5); - III-rd vertical axis (point 8); - IV-th vertical axis (point 11).	mm	EN 12211	P = ± 800 Pa +1,68 / -0,42 +3,42 / -2,12 +3,44 / -1,90 +1,63 / -0,43	P = ± 800 Pa f < (1/300) L < ±5,33 < ±5,33 < ±5,33 < ±5,33
2.2	Repeated pressure test - 50 times positive and negative pressures	-		P = ± 400 Pa Functional qualities and links with hardware are reserved.	P = ± 400 Pa Functional qualities of the window and links with hardware to be reserved.
2.3	Safety test at triple pressure	-		P = ± 1200 Pa Functional qualities and links with hardware are reserved.	P = ± 1200 Pa Functional qualities of the window and links with hardware to be reserved.
* Detailed test results are given in Annex 3 of the test report.					
3.	Load-bearing capacity devices *	class		4	EN 13115
3.1	Bending at load with a horizontal force for 5 min that is applied to the wing with hinges. The wing is rotated on a vertical axis and is locked at the top.	mm	EN 14609	P = 350 N a _{residual} = 135 mm Functional qualities and links with hardware are reserved	P = 350 N Functional qualities of the window and links with hardware to be reserved
3.2	Bending at load with a horizontal force for 5 min that is applied to the wing with hinges. The wing is rotated on a horizontal axis and is locked at one end.			P = 350 N a _{residual} = 86 mm Functional qualities and links with hardware are reserved	P = 350 N Functional qualities of the window and links with hardware to be reserved
* Detailed test results are given in Annex 4 of the test report.					

1	2	3	4	5	6
4	Airborne sound insulation – weighted sound reduction index, $R_w (C; C_{tr})$ *	dB	EN ISO 10140-2	37 (-1; -2)**	-
* Weighted sound reduction index, $R_w (C; C_{tr})$ dB, according to EN ISO 717-1.					
** Detailed test results are given in Annex 5 of the test report.					
5	Thermal transmittance coefficient: - the profile wing - the profile fund - the profile transon - the insulating glass unit - the window	W/(m ² .K)	EN ISO 10077-1	1,58 1,43 1,67 0,69 0,89	- - -
6	Air permeability *	class	EN 1026	4	EN 12207 The requirements are given at Annex 6 of the test report.
* Detailed test results are given in Annex 6 of the test report.					

Technical documentation:


EN 14351-1:2006+A1:2010	Windows and doors. Product standard, performance characteristics. Part 1: Windows and external pedestrian doorsets without resistance to Fire and/or smoke leakage characteristics;
EN 14609:2005	Windows. Determination of the resistance to static torsion;
EN 12211:2003	Windows and doors. Resistance to wind load. Test method;
EN 1027:2003	Windows and doors. Watertightness. Test method;
EN 1026:2003	Windows and doors. Air permeability. Test method;
EN ISO 10140-2:2010	Acoustics. Laboratory measurements of sound insulation of building elements. Part 2: Measurement of airborne sound insulation.;
EN ISO 717-1:2013	Acoustics. Rating of sound insulation in buildings and of building elements. Part 1: Airborne sound insulation;
EN ISO 12567-1:2010	Thermal performance of windows and doors - Determination of thermal transmittance by the hot-box method - Part 1: Complete windows and doors
EN 12208: 2003	Windows and doors. Watertightness. Classification;
EN 12210:2003	Windows and doors. Resistance to wind load. Classification;
EN 13115:2004	Windows. Classification of mechanical properties. Racking, torsion and operating forces;
EN 12207:2003	Windows and doors. Air permeability. Classification.

Tests are carried out by:

1. Eng. O. Savov
2. Res. Ass. Eng. K. Glushkova

Head of Test Laboratory

Res. Ass. Eng. Tsvetana Gyurova




Data of window for testing

Name of product: Window aluminum profiles „VIVA ALUMINIUM SYSTEMS“ Opening system with thermal break TBO 55


Description of test specimen: Three section window with right wing - biaxial opening; middle part – no opening, left wing - uniaxial opening:

- dimensions 1750/2550 mm;
- Glazing – glass with a total thickness of 38 mm (6 mm high energy glass, 5 mm white glass; sound control 4.4.1 - 6981 mm*1578 mm);
- Used Al profiles:
 - Fund thermo - 5501;
 - wing window euros channel thermo - 5502;
 - divider thermo - 5505;
 - glazing - 3817;
- Seals:
 - G01 - waiting rubber;
 - GO2 - ramming rubber;
 - 220.15001.01 - waiting rubber;
 - 108 N70 - waiting rubber;
 - G05 - medium rubber;
- Hardware - "GU".


Note: Detailed drawings of the test specimen are shown on p. 7 and p. 8.

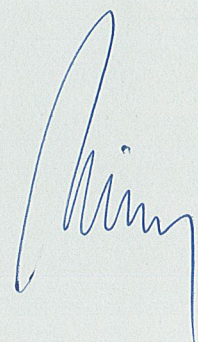

OUTSIDE

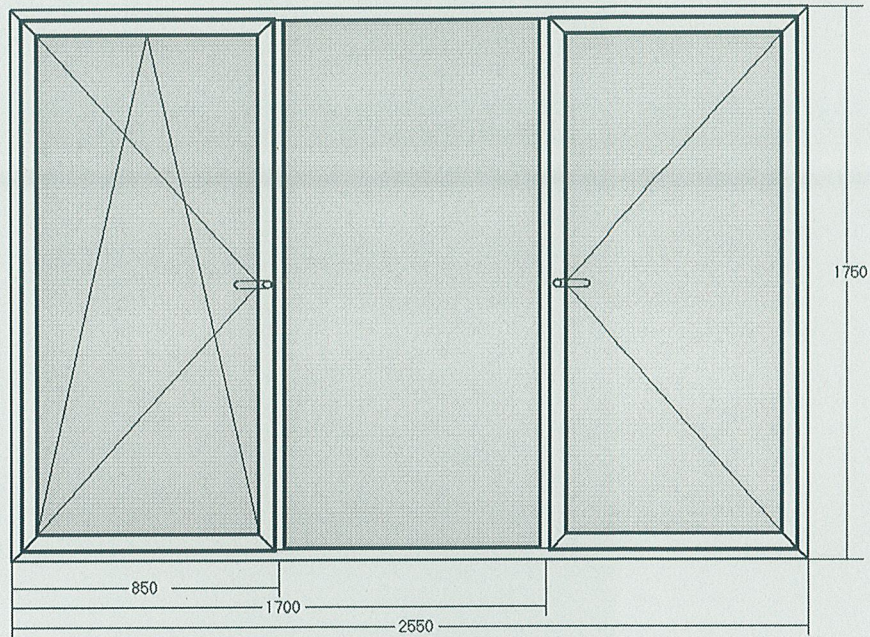


INSIDE

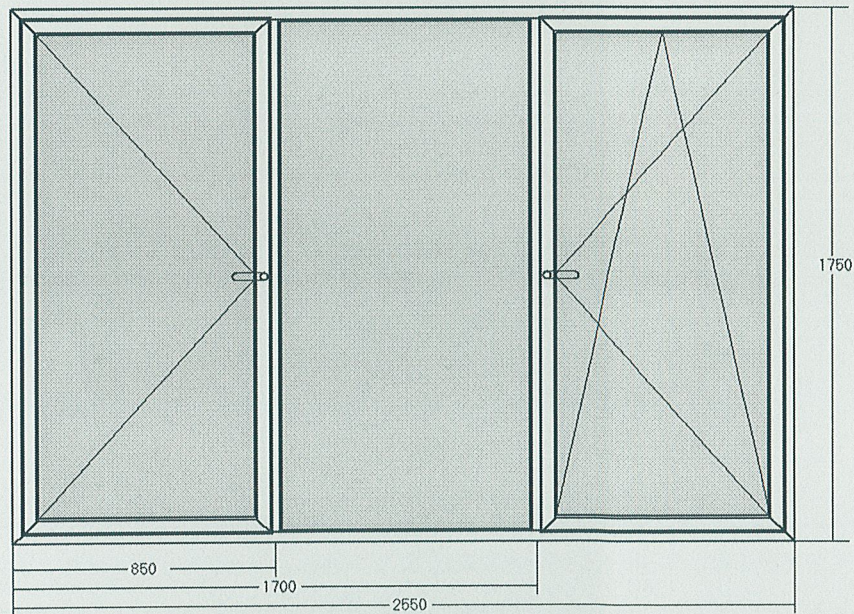

A handwritten signature in blue ink, located in the bottom right corner of the page.



Прекъснат термо мост 5500

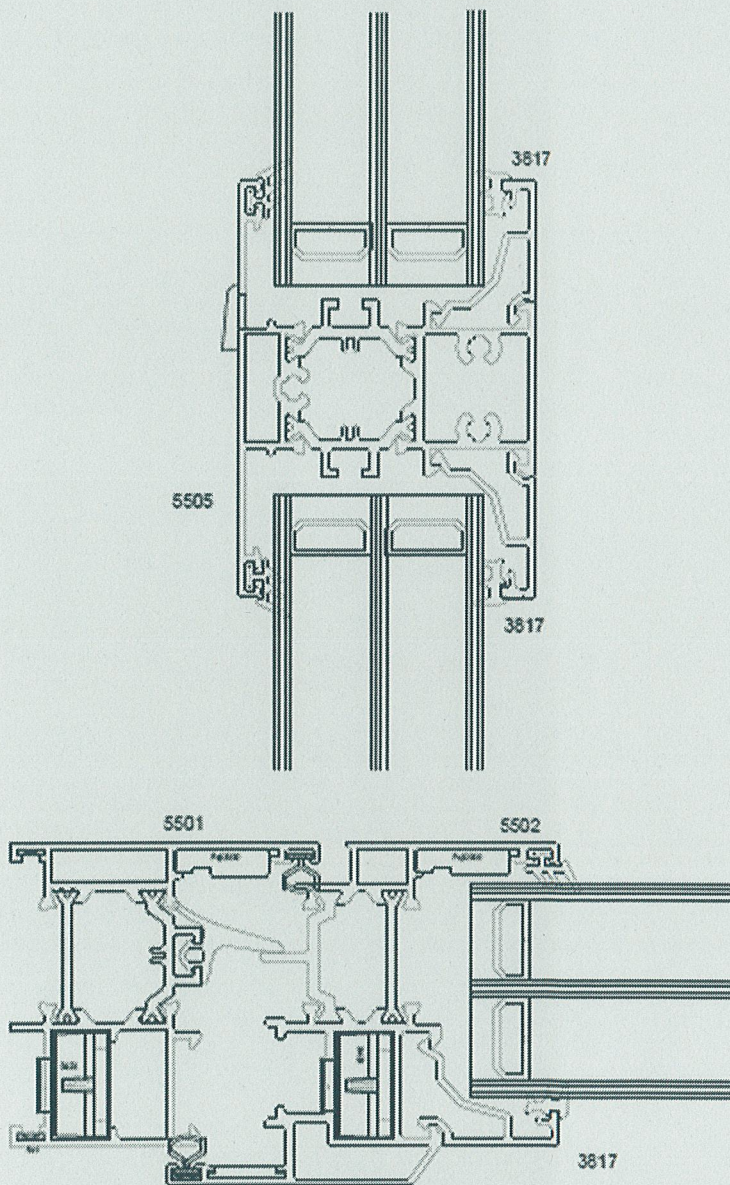

A handwritten signature in blue ink, appearing to read 'Piny', is located in the bottom right corner of the page.

Watertightness – EN 1027

1. Test conditions and test equipment data

The test is carried out on a stand system "Rosenheim" type "VH AE" of HOLTEN located in the Laboratory "Building Physics" at NISI Ltd. The stand consists of a chamber and control and measurement desk. The chamber is airtight and only one of the sides is open. This side is closed by appropriate fixing of testing window that is oriented to the outside of the chamber.

The testing window is fixed to the spacers (the chamber sides) by manual clamps. Microporous rubber seals are used between the window frame and the chamber walls for good seal.


Water quantity – 2 dm³ per 1 m²/min.

Air temperature in the chamber and the laboratory is 20 °C.

Relative humidity in the chamber and the laboratory is 50 %.

2. Test results

Test pressure, Pa	Continu- ance, min	Results of the monitoring on the internal face of the test specimen		Classification		Requirements according to EN 12208
		Method A	Method B	Method A	Method B	
0	15	не	не	1A	1B	Water resistan at water spray for 15 min
50	5	не	не	2A	2B	As class 1 + 5 min
100	5	не	не	3A	3B	As class 2 + 5 min
150	5	не	не	4A	4B	As class 3 + 5 min
200	5	не	не	5A	5B	As class 4 + 5 min
250	5	не	не	6A	6B	As class 5 + 5 min
300	5	не	не	7A	7B	As class 6 + 5 min
450	5	не	да	8A	-	As class 7 + 5 min
600	5	не	-	9A	-	As class 8 + 5 min

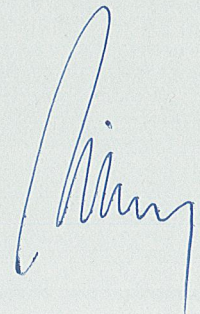


Resistance to wind load – БДС EN 12211

1. Test conditions and equipment data

The test equipment and the chamber are in accordance with Annex 2 of the test report.
Air temperature in the chamber and the laboratory is 16 °C.
Relative humidity in the chamber and the laboratory is 72 %.

2. Testing of deformation (deflections)

Measurement of deformations (deflections) of the linear elements in height of the window wings is made using measuring devices type TGL 7682 accurate to 0,01 mm (produced of SUHL, Germany).

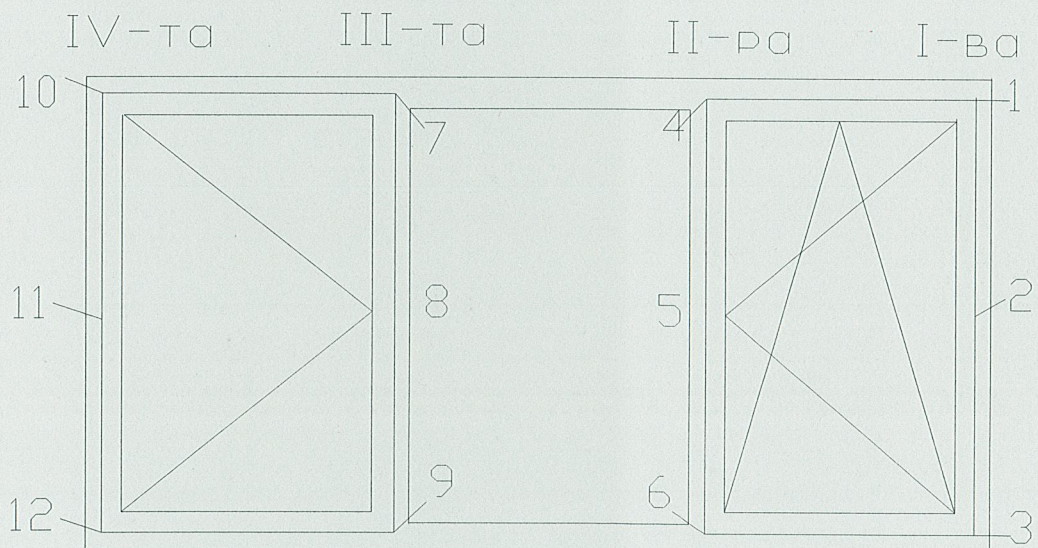

Disposition scheme of measuring points on the window

Test results

Test pressure, Pa	Deflection in mm		
	I-st vertical axis		
	f_p ($f_{p\text{res.}}$) at p.1	f_p ($f_{p\text{res.}}$) B T.2	f_p ($f_{p\text{res.}}$) B T.3
+400 / -400	+0,13 / -0,27 (+0,01/-0,09)	+0,61 / -0,53 (+0,02/-0,06)	+0,12 / -0,18 (+0,02/-0,08)
+800 / -800	+0,30 / -0,57 (+0,07/-0,14)	+1,94 / -0,95 (+0,04/-0,06)	+0,23 / -0,49 (+0,06/-0,23)
	II-st vertical axis		
	f_p ($f_{p\text{res.}}$) at p.4	f_p ($f_{p\text{res.}}$) at p.5	f_p ($f_{p\text{res.}}$) B T.6
+400 / -400	+0,81 / -0,99 (+0,24/-0,24)	+1,99 / -1,90 (0,31/-0,29)	+0,67 / -0,63 (+0,18/-0,12)
+800 / -800	+1,41 / -1,71 (+0,27/-0,32)	+4,72 / -3,76 (+0,36/-0,43)	+1,18 / -1,55 (+0,19/-0,29)
	III-st vertical axis		
	f_p ($f_{p\text{res.}}$) at p.7	f_p ($f_{\text{ocr.}}$) at p.8	f_p ($f_{\text{ocr.}}$) at p.9
+400 / -400	+0,47 / -0,76 (+0,19/-0,24)	+1,39 / -1,61 (+0,29/-0,24)	+0,53 / -0,67 (+0,21/-0,11)
+800 / -800	+1,44 / -1,69 (+0,24/-0,34)	+4,76 / -3,58 (+0,37/-0,49)	+1,21 / -1,66 (+0,17/-0,27)
	IV-st vertical axis		
	f_p ($f_{p\text{res.}}$) at p.10	f_p ($f_{p\text{res.}}$) at p.11	f_p ($f_{p\text{res.}}$) at p.12
+400 / -400	+0,08 / -0,07 (+0,02/-0,03)	+0,38 / -0,31 (+0,04/-0,09)	+0,06 / -0,04 (+0,01/-0,01)
+800 / -800	+0,22 / -0,12 (+0,05/-0,07)	+1,83 / -0,53 (+0,02/-0,08)	+0,18 / -0,08 (+0,04/-0,02)

* $f_{p\text{res}}$ is residual deflection.

3. Repeated pressure test

The test is implemented at a pressure of ± 400 Pa, repeated 50 times.

At the repeated 50 cycles test including negative and positive pressure of 400 Pa, that simulate the window behavior at the wind blows (pressure and suction) defects and damages that deteriorate the window performance are not detected.

4. Safety test at triple pressure

The test is carried out at positive and negative pressure ± 1100 Pa only once.

Damages that deteriorate the window performance are not detected during the safety test at triple pressure.

Load-bearing capacity devices – БДС EN 14609

1. Test equipment data

Deformations of the linear elements of the wings are measured by inductive displacement sensors type TS 50 W accurate to 0,01 mm and amplifier of carrier frequency KWS 673 A4 (produced of HBM, Germany).

2. Test results

2.1 Bending load with a horizontal force F , in N, for 5 min, applied to one side of the wing hinges, rotating on a horizontal axis locked at the other end.

$F = 20$ N: $a_0 = 101$ mm;

$F = 200$ N: $a_1 = 156$ mm; $a_r = a_1 - a_0 = 55$ mm; $a_{\text{oct.}} = 1$ mm

$F = 250$ N: $a_1 = 165$ mm; $a_r = a_1 - a_0 = 64$ mm; $a_{\text{oct.}} = 1$ mm

$F = 300$ N: $a_1 = 178$ mm; $a_r = a_1 - a_0 = 77$ mm; $a_{\text{oct.}} = 1$ mm

$F = 350$ N: $a_1 = 187$ mm; $a_r = a_1 - a_0 = 86$ mm; $a_{\text{oct.}} = 1$ mm

Functional qualities and links with overlaid are reserved.

2.2 Bending load with a horizontal force F , in N, for 5 min, applied to the bottom of the wing hinges, rotating on a vertical axis locked at the top.

$F = 20$ N: $a_0 = 300$ mm


$F = 200$ N: $a_1 = 220$ mm; $a_r = a_1 - a_0 = 75$ mm; $a_{\text{oct.}} = 0$ mm

$F = 250$ N: $a_1 = 210$ mm; $a_r = a_1 - a_0 = 93$ mm; $a_{\text{oct.}} = 0$ mm

$F = 300$ N: $a_1 = 199$ mm; $a_r = a_1 - a_0 = 112$ mm; $a_{\text{oct.}} = 1$ mm

$F = 350$ N: $a_1 = 197$ mm; $a_r = a_1 - a_0 = 135$ mm; $a_{\text{oct.}} = 2$ mm

Functional qualities and links with overlaid are reserved.

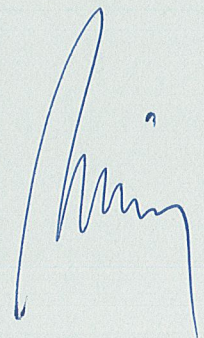

Airborne sound insulation – EN ISO 10140-2, EN ISO 717-1

1. Test conditions, test facilities and equipment data


The test is carried out at “Building physics” laboratory:

- Air temperature 15 °C; relative humidity 59 %
- Source room V = 170 m³;
- Receiving room V = 119 m³;
- Filling wall with R_w = 50 dB;
- Acoustic equipment “Brüel & Kjær” - Denmark:
 - Analyzer for building acoustics Type 4418;
 - Microphone Type 4166;
 - Preamplifier Type 2916;
 - Source noise Type 4292;
 - Sound calibration Type 4230.

The test specimen is installed by the specialists of Applicant.

2. Test results

f, Hz	100	125	160	200	250	315	400	500	630	800	1000	1250	1600	2000	2500	3150
R, dB	25,4	19,9	31,9	36,3	32,6	34,2	34,5	33,9	34,4	35,1	38,5	39,2	37,9	36,2	37,9	41,2

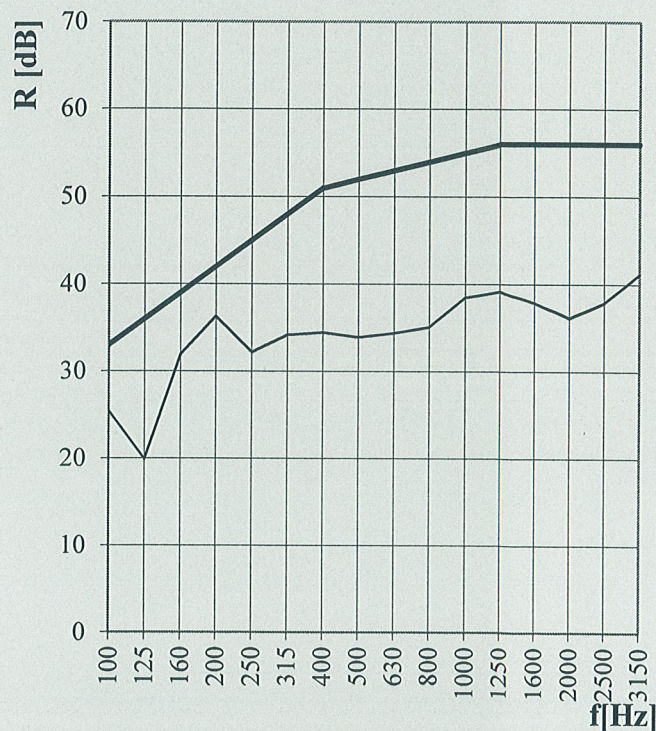

— Нормативна крива
 — Резултат

WEIGHTED SOUND REDUCTION INDEX

R_w (C; C_{tr}) = 37 (-1; -2) dB

Air permeability – EN 1026

1. Test conditions and test equipment data

The test equipment is in accordance with Annex 2 of the test report.

Air temperature in the receiving room is 17 °C.

Relative humidity in the receiving room is 75 %.


2. Test results

Length of opening joints – 10 m, overall window area – 4,38 m²

P, Pa	50	100	150	200	250	300	400	500	600
V, m ³ /h	1,9	2,2	2,8	3,3	3,5	3,8	5,2	7,3	8,5
V1, m ³ /hm	0,07	0,26	0,31	0,35	0,42	0,58	0,72	0,80	0,89
Vw, m ³ /hm ²	0,21	0,59	0,94	1,70	2,32	2,87	3,68	4,18	5,42

Air permeability – classification:

- overall area – class 4;
- length of opening joints – class 4.

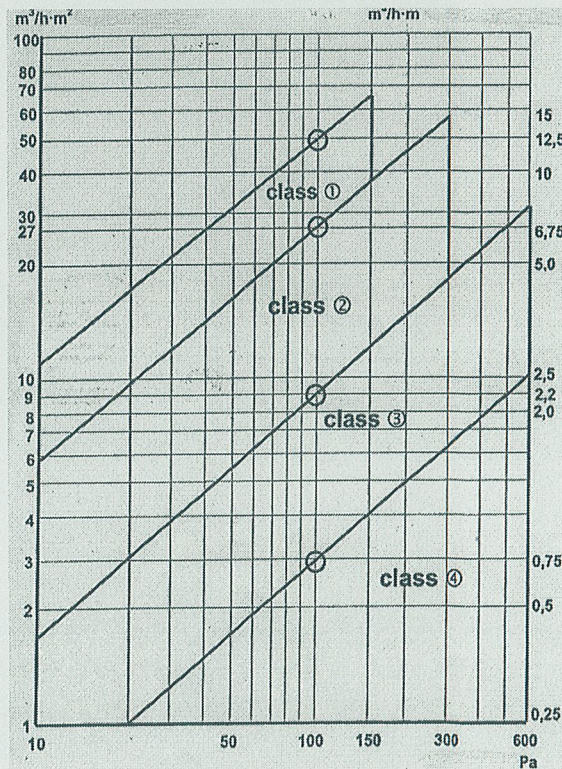

Classification